
IIIACO INFRASTRUCTURE

INSTALLATION DRAWING

DRWG# XIXR-DC-1

Qmax 225/300/350 Load Class D: Concrete

ACO Limited New Zealand Ph: 0800 448 080 www.aconz.co.nz sales@aconz.co.nz

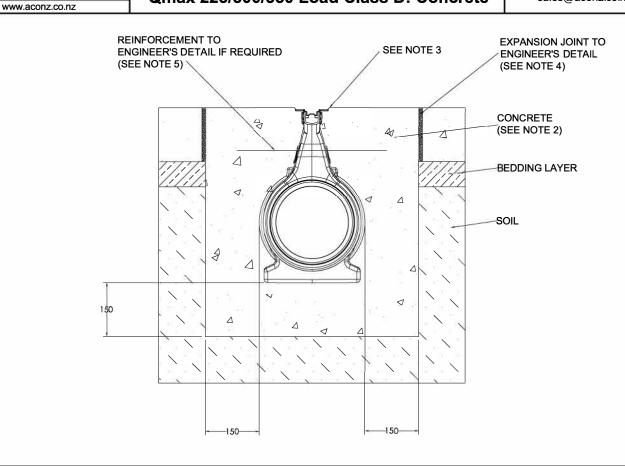

NOTES:

- 1. Specific site conditions may require an increase in these dimensions or reinforcement. It is the customer's responsibility to ensure the concrete encasement is designed for the application. *Engineering advice may be required.*
- 2. A minimum concrete strength of 25MPa is recommended. The concrete should be vibrated to eliminate air pockets.
- 3. The finished level of the concrete surround must be approx. 3-5mm above the top of the channel slot. During site work and concrete pour, ensure that the plastic protective strip (supplied with Q-Flow slot) is not damaged or displaced, in order to prevent debris entering the channel during construction.
- 4. Expansion and crack control joints are recommended to protect the channel and the concrete surround. Engineering advice may be required.
- 5. Slab reinforcement (if any) can be continued through the Qmax arch detail under the slot. Engineering advice may be required.

IIIACO INFRASTRUCTURE	SPECIFICATION CLAUSE	ACO Limited New Zealand Ph: 0800 448 080
DRWG# XIXR-DC-1	Qmax 225 / 300 / 350* System	www.aconz.co.nz sales@aconz.co.nz
www.aconz.co.nz	Qillax 2237 3007 330 Gystelli	3aie3@ac0112.co.112

The slot drainage system shall be ACO's Qmax 225 / 300 / 350* system as manufactured by ACO Pty Ltd.

ACO's **Qmax 225 / 300 / 350*** polyethylene (PE) channels have a stiff rib design providing high strength pavement beam feature allowing necessary keying of concrete. The 2000mm long lightweight PE channels have a simple push-fit male/female watertight connection and levelling feet for ease of installation and stability.

The constant depth / stepped* system shall be complete with the Q-Flow galvanised steel 26mm wide slot.

ACO's Qmax 225 / 300 / 350* channels shall be connected to a Qmax 225/300/350 access unit / pit* with slotted grate (Optional).*

All materials and components within the scope of this system shall be obtained from this manufacturer and the work shall be carried out as specified on the drawings.

*Delete where appropriate