

ACO CABLEMATE®


**POLYCRETE® PITS
INSTALLATION DRAWING**

DWG# IC009
www.aconz.co.nz



SIT Pit Assembly

General Delethalisation Detail

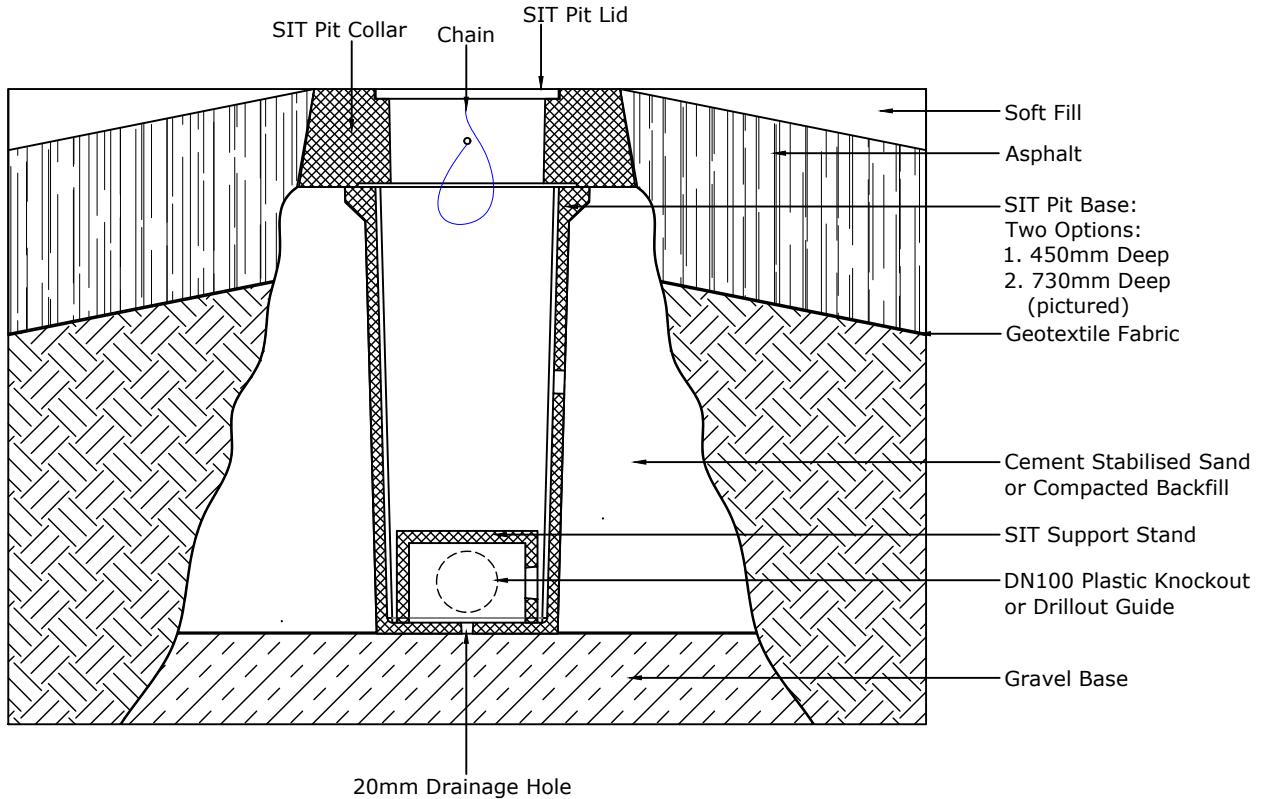

NOTES:

1. Specific site conditions will require a modification to these general details.
2. It is the customer's responsibility to ensure effective delethalisation occurs and the pit structure is protected from undue stress.
3. If in doubt, seek engineering advice.

ACO CABLEMATE®

**POLYCRETE® PITS
SPECIFICATION CLAUSE**

DRWG# IC009
www.aconz.co.nz

SIT Pit Assembly

ACO Limited
35 Te Tiki Road
Mangere, Auckland 2022
Tel: 0800 448 080
Email: info@aconz.co.nz

The Series Isolation Transformer (SIT) pit comprises a polymer concrete pit (part no.....) and galvanised lid (part no.....). A polymer concrete stand (part no. 142319) is also available to support series isolation transformer above the base of the pit. The lid and collar is rated to 25 tonnes.

All materials and components within the scope of the system shall be obtained from ACO.