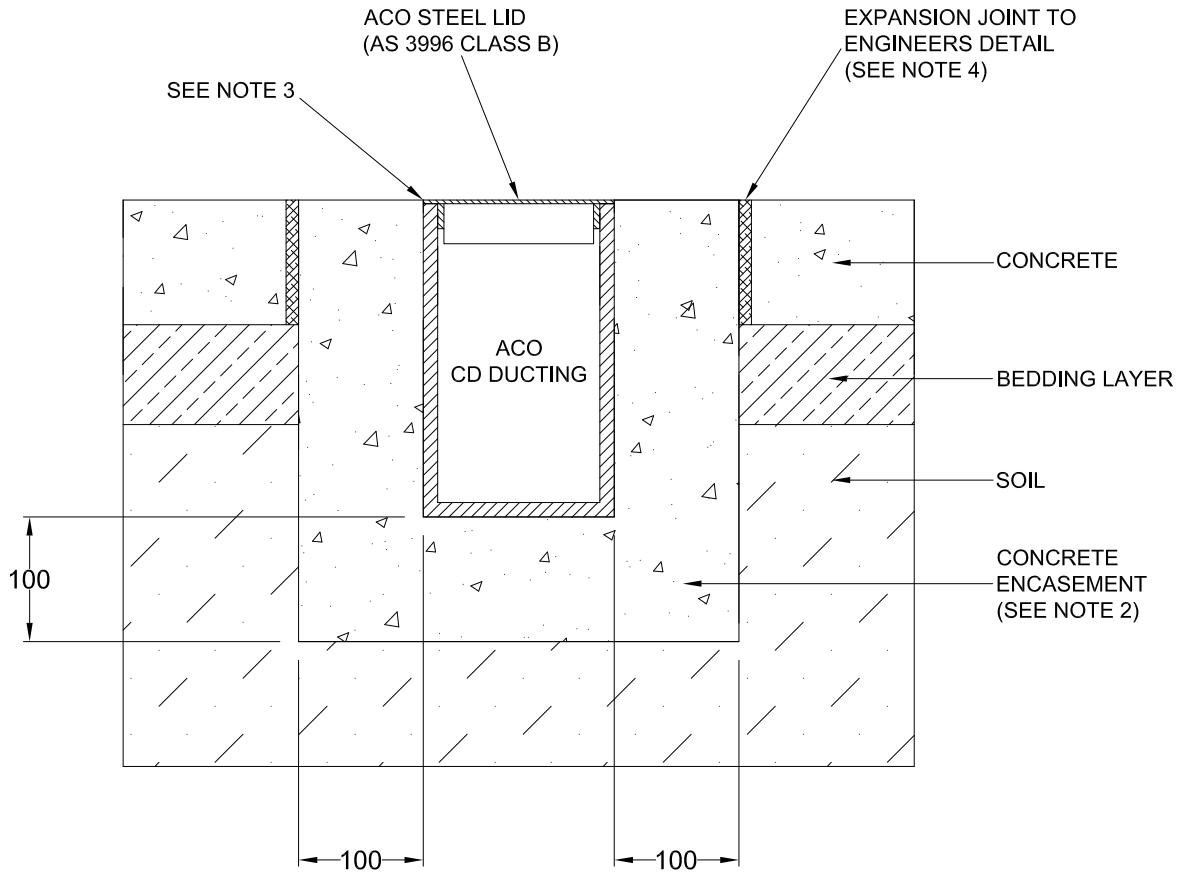


Start Your  
Specification  
Here

## NOTES:

1. Specific site conditions may require an increase in these dimensions or reinforcement. It is the customer's responsibility to ensure the concrete encasement is designed for the application. *Engineering advice may be required.*
2. A minimum concrete strength of 25MPa is recommended. The concrete should be vibrated to eliminate air pockets.
3. The finished level of the concrete encasement must be flush with the top of the lid.
4. Expansion and crack control joints are recommended to protect the ducting and concrete encasement. *Engineering advice may be required.*
5. Refer to ACO's latest installation instructions for complete details.

The surface cable ducting system (for a nominal wheel load of 2670kg) with *clear opening(s)* of ..... shall be **ACO Cablemate® CD**..... ducting channel(s) and *part no.(s)* ..... with Steel lid(s) and *part no.(s)* .....

All materials and components within the scope of this system shall be obtained from ACO Polycrete Pty Ltd and the work shall be carried out as specified in accordance with the manufacturer installation recommendations.