

ACO CABLEMATE®

**POLYCRETE® PIT  
INSTALLATION DRAWING**

DRWG# XCPG-BG-3


www.aconz.co.nz

**With Steel / PowerLok® Lid**

**Grass: For 2670kg Nominal Wheel Load**



Start Your  
Specification  
Here

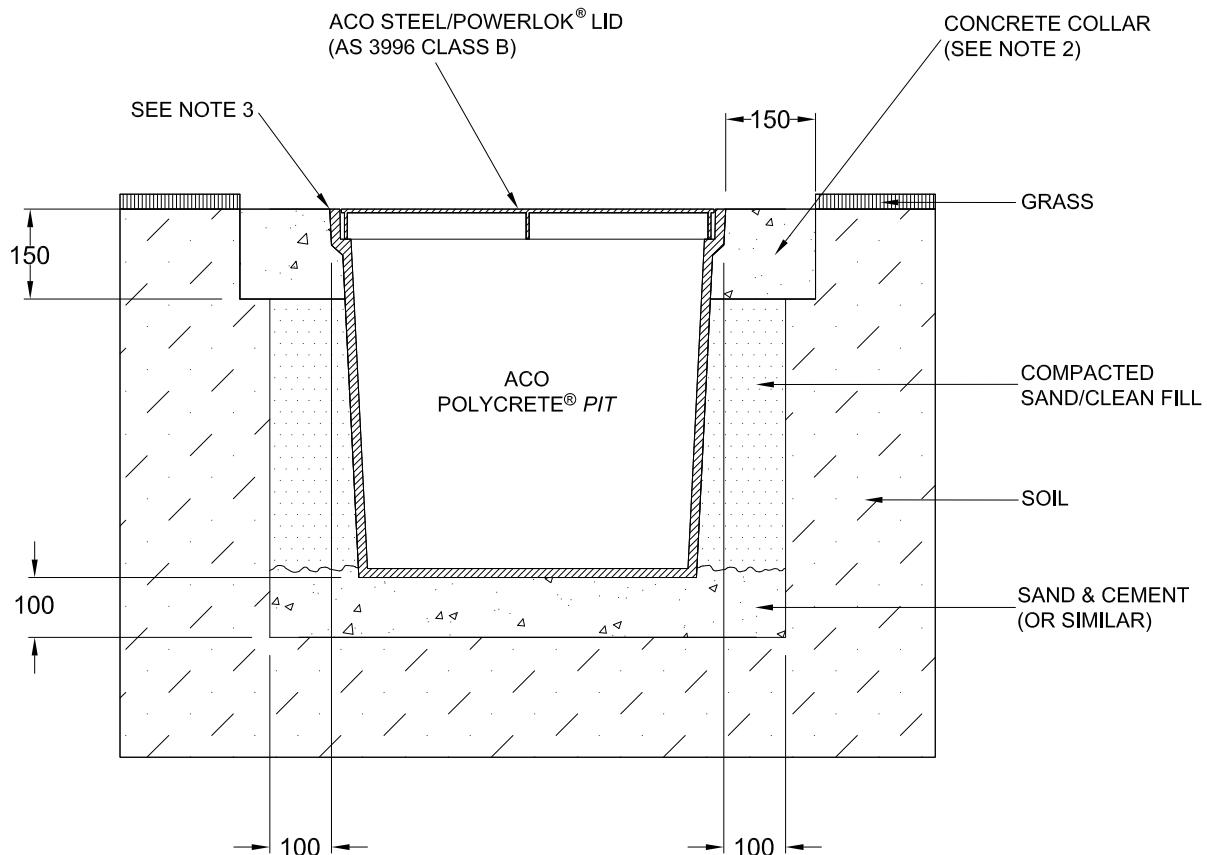

**NOTES:**

1. Specific site conditions may require an increase in these dimensions or reinforcement. It is the customer's responsibility to ensure the installation drawing is detailed for the application and pit structure is protected from undue stress. *Engineering advice may be required.*
2. A minimum strength of 25MPa is recommended for the collar. Concrete should be vibrated to eliminate air pockets.
3. The finished level of the concrete collar must be flush with the top of the pit.
4. Refer to ACO's latest installation instructions for complete details.

ACO CABLEMATE®

**POLYCRETE® PIT  
SPECIFICATION CLAUSE**

DRWG# XCPG-BG-3

www.aconz.co.nz

**With Steel / PowerLok® Lid**

ACO Limited  
35 Te Tiki Road  
Mangere, Auckland 2022  
Tel: 0800 448 080  
Fax: +64 9255 5114  
Email: info@aconz.co.nz

The cable enclosure(s) (for a nominal wheel load of 2670kg) with a *clear opening(s)* of ..... shall be **Polycrete® Pit(s) Type (s) .....** and *part no.(s)* ..... with Steel / **PowerLok®** lid(s) and *part no.(s)* .....

All materials and components within the scope of the system shall be obtained from ACO and the work shall be carried out as specified in accordance with the manufacturer installation recommendations.