

ACO CABLEMATE®

POLYCRETE® PIT
INSTALLATION DRAWING

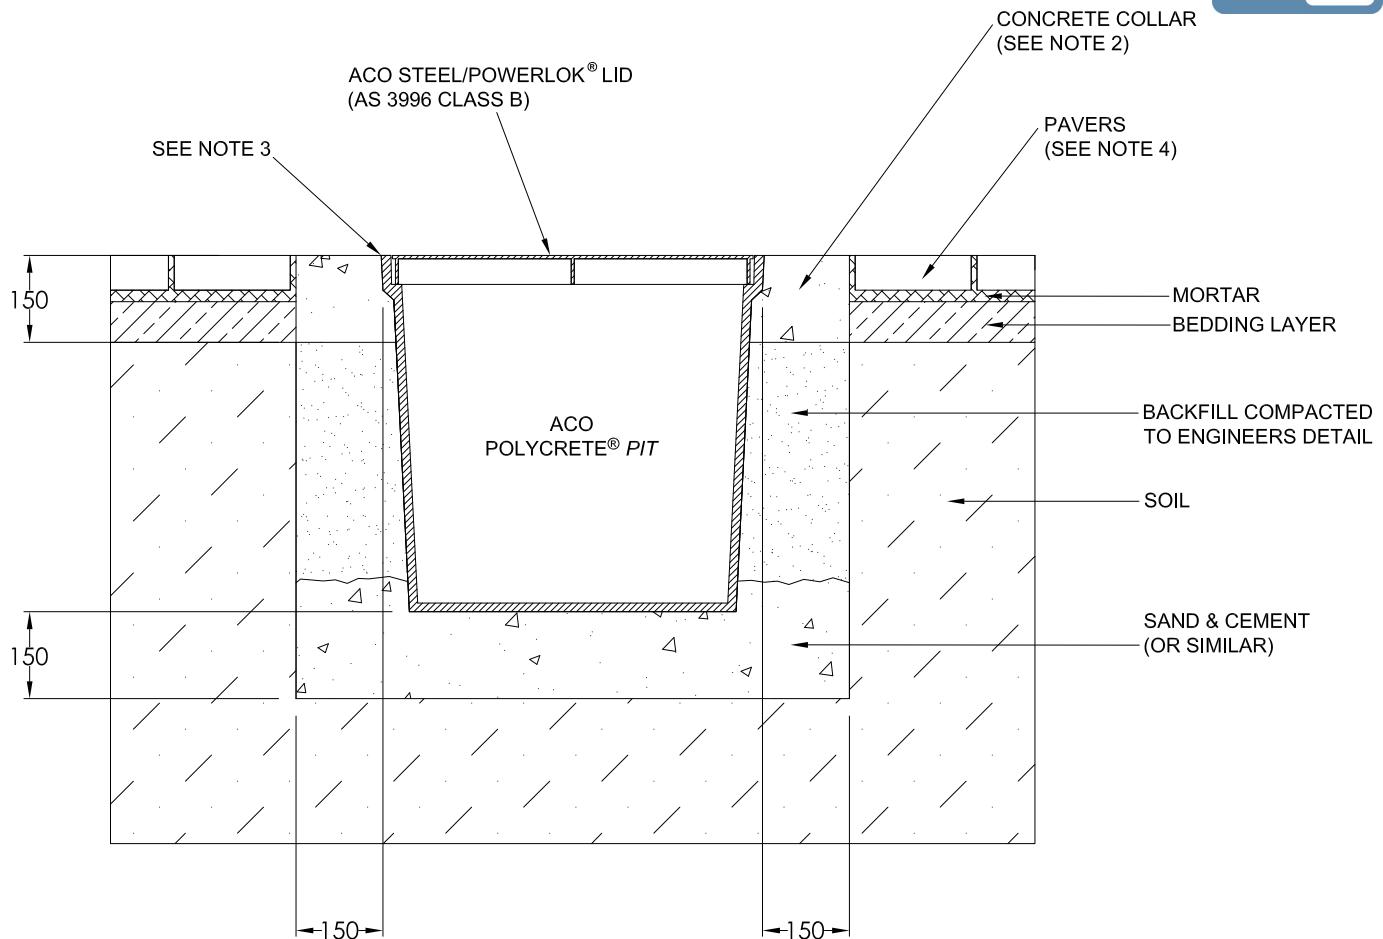
DRWG# XCPG-CP-3

www.aconz.co.nz

With Steel / PowerLok® Lid



Pavers: For 5000kg Nominal Wheel Load

Start Your
Specification
Here

NOTES:

1. Specific site conditions may require an increase in these dimensions or reinforcement. It is the customer's responsibility to ensure the installation drawing is detailed for the application and pit structure is protected from undue stress. *Engineering advice may be required.*
2. A minimum concrete strength of 25MPa is recommended for the collar. The concrete should be vibrated to eliminate air pockets.
3. The finished level of the concrete collar must be flush with the top of the pit.
4. The paver course adjacent to the concrete collar must be flush with the collar and must be fully bonded to the mortar.
5. Refer to ACO's latest installation instructions for complete details.

ACO CABLEMATE®

POLYCRETE® PIT
SPECIFICATION CLAUSE

DRWG# XCPG-CP-3

www.aconz.co.nz

With Steel / PowerLok® Lid

ACO Limited
35 Te Tiki Road
Mangere, Auckland 2022
Tel: 0800 448 080
Fax: +64 9255 5114
Email: info@aconz.co.nz

The cable enclosure(s) (for a nominal wheel load of 5000kg) with a *clear opening(s)* of shall be **Polycrete Pit(s) Type (s)** and *part no.(s)* with Steel / **PowerLok** lid(s) and *part no.(s)*
®

All materials and components within the scope of the system shall be obtained from ACO and the work shall be carried out as specified in accordance with the manufacturer installation recommendations.